


PGE Reliability Area Power Quality Monitoring (Example)
 Sag Events vs. SEMI F47
 (Tool Ride-Through Standard)

Q1 2009
 YTD

PQ Meter: McGill WR1 13kV

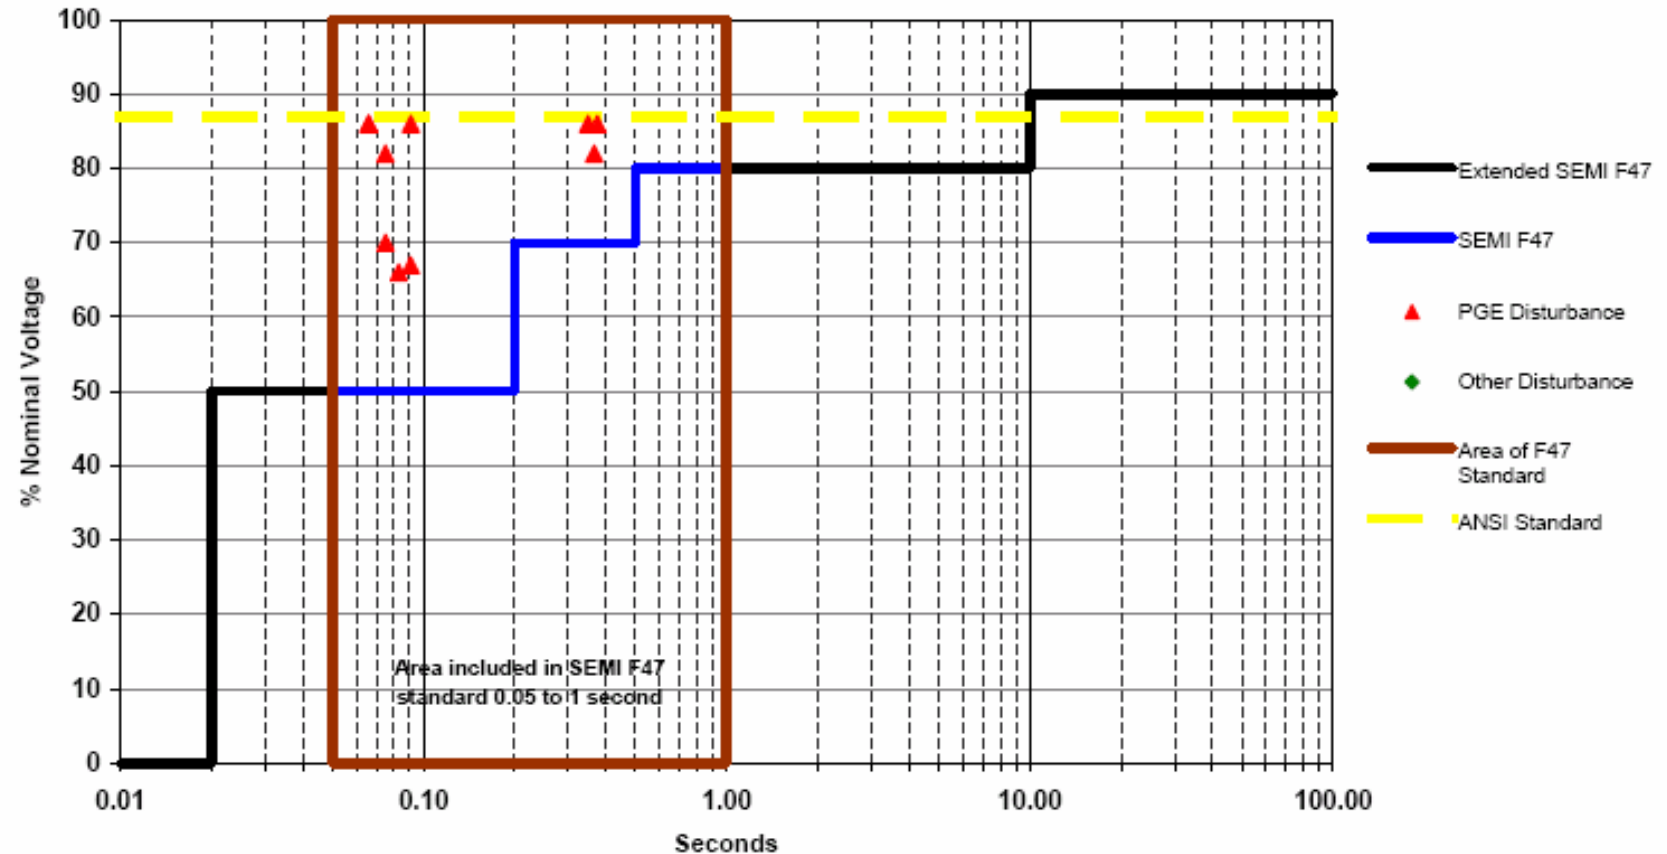

Note:
 Metering Point may be at the substation. Therefore, voltage magnitudes are approximation of what is experienced at the customer site. ANSI C84.1 Utilization Voltage Lower Limit (87% of Nominal Voltage)

SARFI_{SEMI} = 0